


MOBILE HOME SERVICE TERMINATION

DIRECT WIRE TYPE TO SERVICE POLE

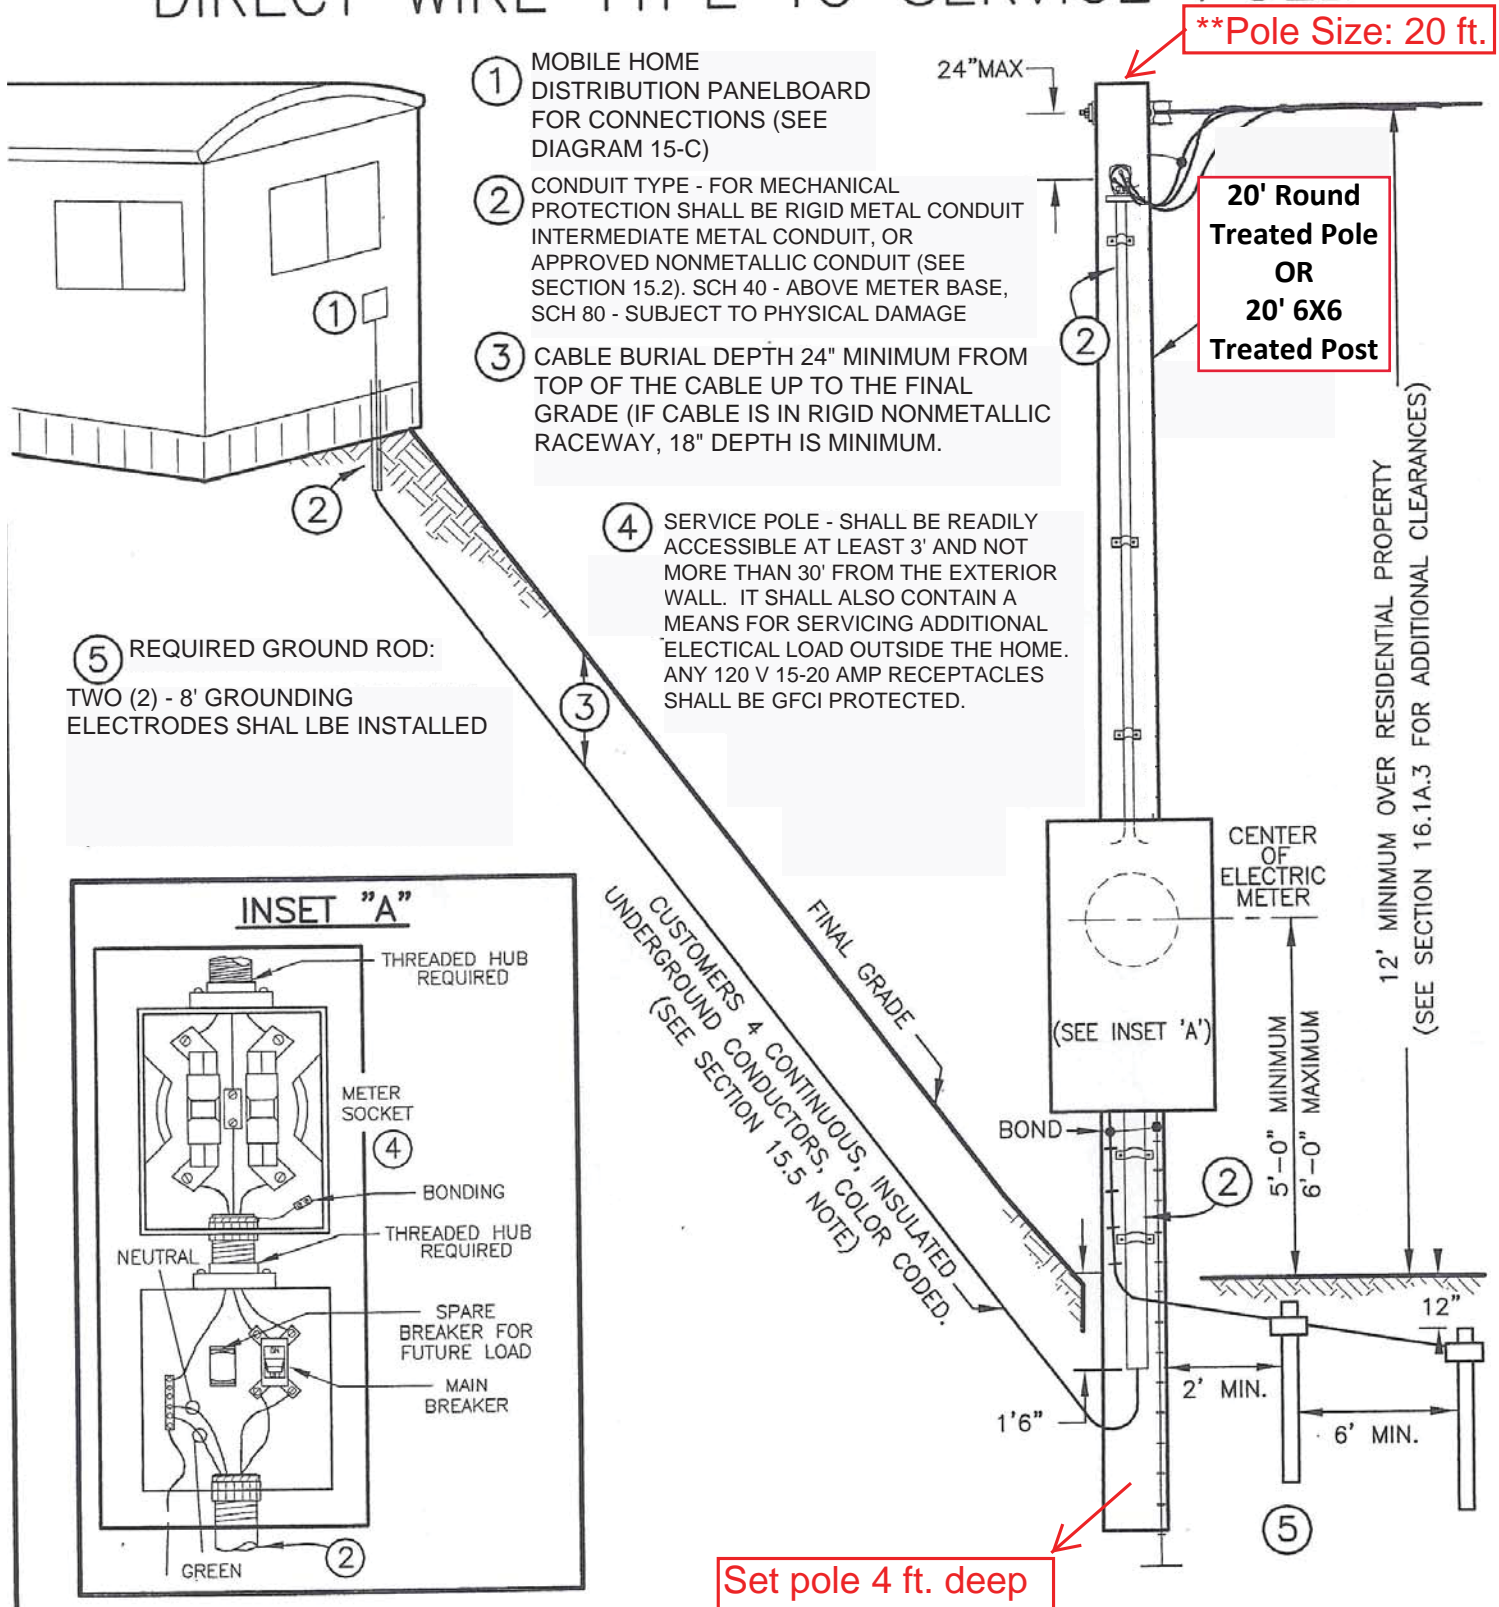

| AMPS | SERVICE ENTRANCE WEATHERHEAD TO DISCONNECT CONDUCTOR THW OR EQUIV. | | | | FEEDER CIRCUIT SERVICE POLE TO MOBILE HOME CONDUCTOR RHW,UF,URD,OR EQUIV. | | | | INSULATED COPPER GROUNDING WIRE (GREEN) |
|------|--|---------|------|---------|---|---------|------|---------|---|
| | COPPER | CONDUIT | ALUM | CONDUIT | COPPER | CONDUIT | ALUM | CONDUIT | |
| 100 | #4 | 1 1/4" | #2 | 1 1/4" | #4 | 1 1/4" | #2 | 1 1/4" | #8 |
| 200 | #2/0 | 2" | #4/0 | 2" | #2/0 | 2" | #4/0 | 2" | #6 |

Diagram 15-B