


# 200 AMP UNDERGROUND METER BASE

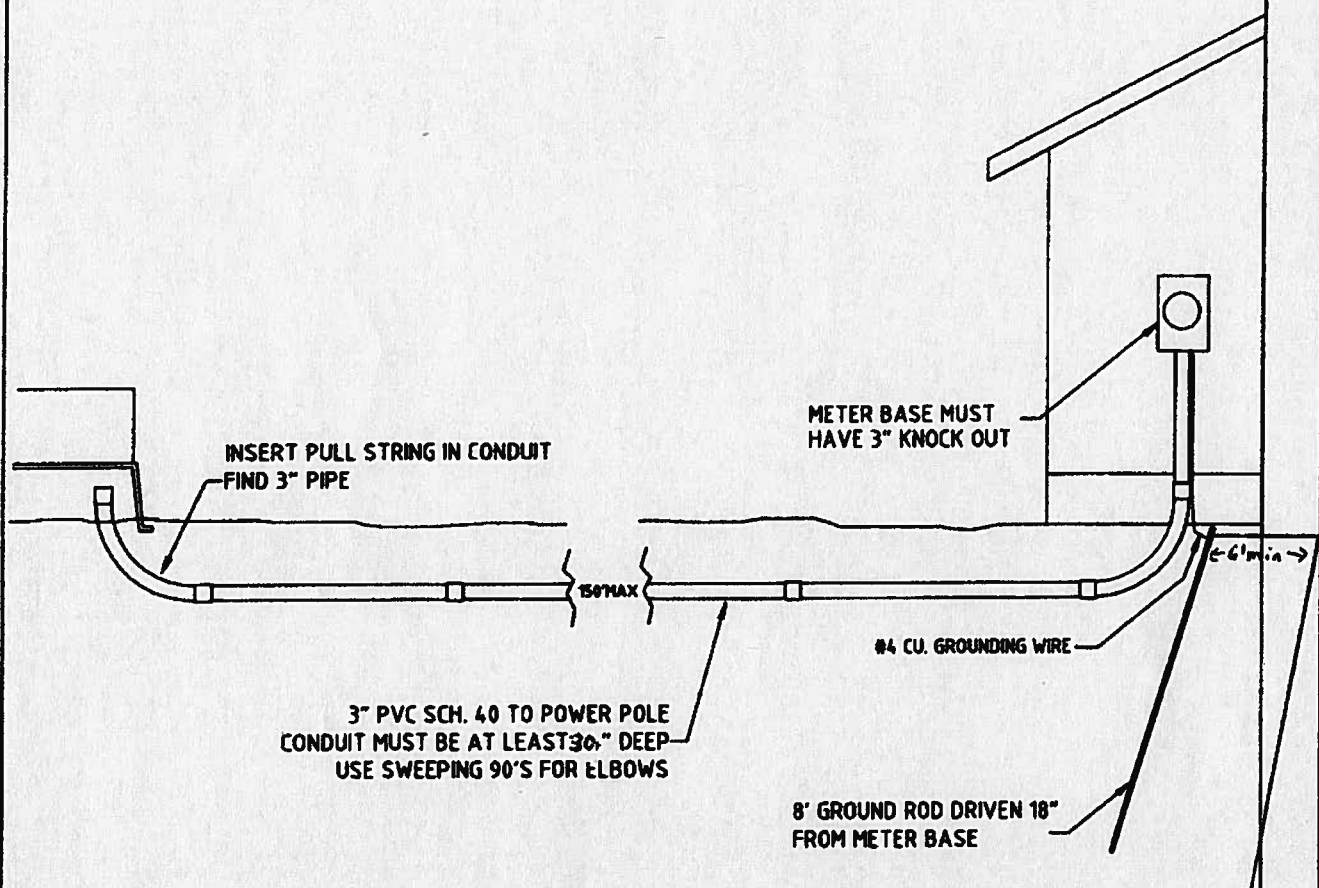


INSERT PULL STRING IN CONDUIT  
FIND 3" PIPE

METER BASE MUST  
HAVE 3" KNOCK OUT

3" PVC SCH. 40 TO POWER POLE  
CONDUIT MUST BE AT LEAST 30" DEEP  
USE SWEEPING 90'S FOR ELBOWS

#4 CU. GROUNDING WIRE

8' GROUND ROD DRIVEN 18"  
FROM METER BASE

 <p><b>FLEMING-MASON</b> <b>ENERGY</b> <small>A Trumbull Energy Cooperative Inc.</small></p>	<b>200 AMP UNDERGROUND METER BASE</b>				
	FSCM NO. <b>XX</b>		DWG NO. <b>200 AMP-UNHO.</b>		
	SCALE <b>NONE</b>	REV	<b>05/17/01</b>	SHEET	<b>1/1</b>